
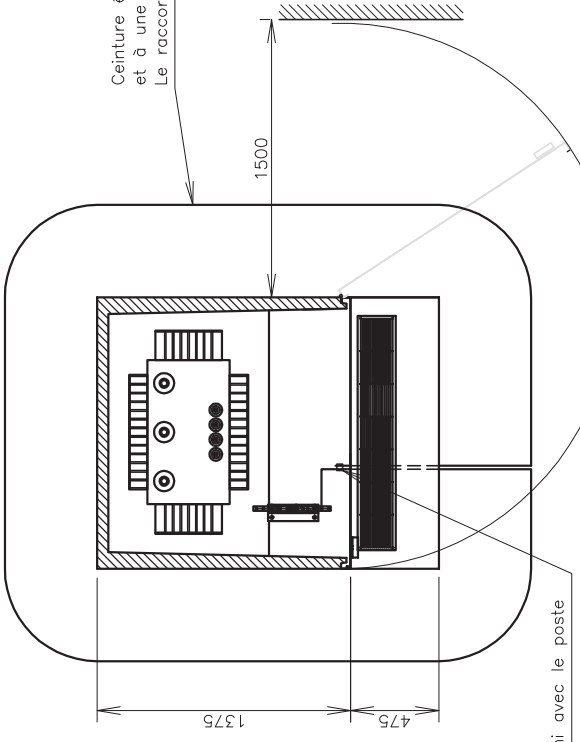


1 2 3 4 5 6 7 8 9 10

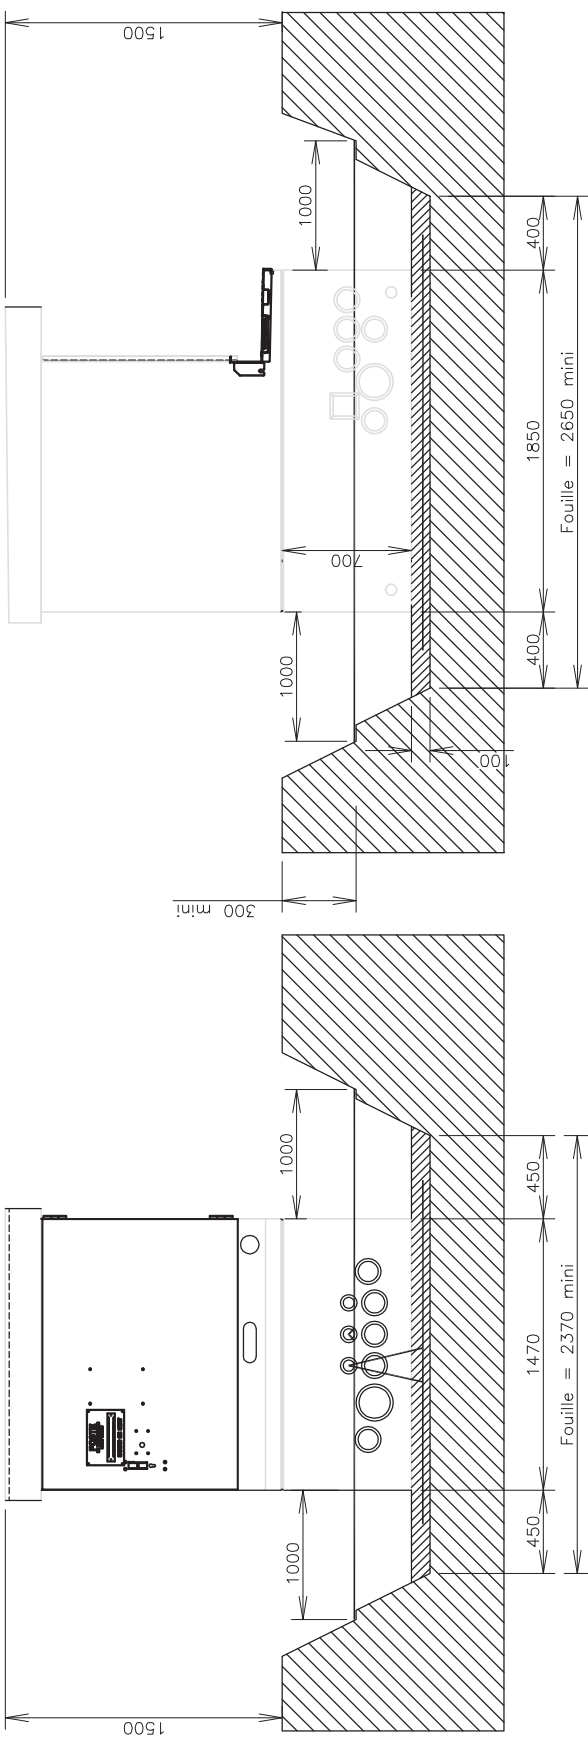

Ceinture equipotentielle située à une profondeur de 30 cm mini et à une distance de 1m autour de l'enveloppe  
Le raccordement se fait à l'intérieur du poste

nota: la boucle de fond de fouille est à poser par l'installateur avant la pose du poste et à raccorder à la platine de terre des masses.

Ech. 1/25 scale		Projet project		DI BIOSCO-PSSA CBT		FOUILLES		FOUILLES		Folio sheet	
Dossier folder		Code diffusion distribution code		Unité/departement EPSYS		03164785		B		001/001	
Schneider Electric		Archiv. micro- filmed		Approve/ approved		V/isa		V/isa		Original AutoCAD format A3	
B.Durmasi Nom/name		V/isa		V/isa		V/isa		V/isa			
Dessine/ draw		Vérifié/ checked		Approve/ approved		V/isa		V/isa			
JCP JMT		V/isa		V/isa		V/isa		V/isa			
MBT JMT		V/isa		V/isa		V/isa		V/isa			
Boucle de fond de fouille		C35 fourni avec le poste		Edition originale/ first issue		Modification/ modification		Note appl appl. memo			
Date date		17/02/07		17/12/15		17/02/07		17/12/15			
Ind rev		A		B		A		B			

All technical information contained in this document is the exclusive property of SCHNEIDER ELECTRIC INDUSTRIES SAS and may neither be used nor disclosed without its prior written consent.